



A B C D E F G H J K L M N P Q

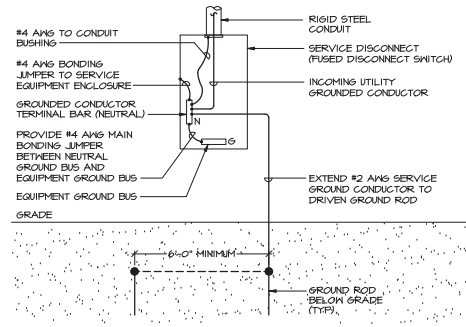


DETAIL - TYPICAL ELECTRIC SERVICE GROUNDING ELECTRODE
NO SCALE

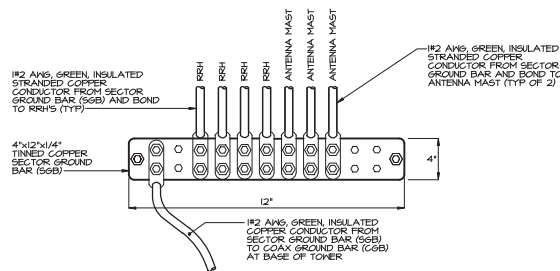


DETAIL - ANTENNA SECTOR GROUND BAR
NO SCALE

NOTE: NO-OX SHALL BE USED ON ALL CONNECTIONS TO GROUND BAR.

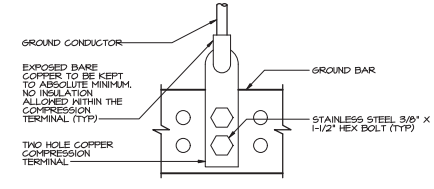


DETAIL - DOUBLE LUG CONNECTION
NO SCALE



DETAIL - GROUND ROD
NO SCALE

GROUND ROD SHALL BE DRIVEN VERTICALLY, NOT TO EXCEED 45 DEGREES FROM THE VERTICAL.

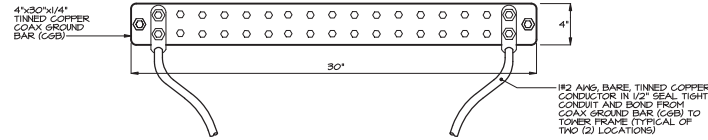

DETAIL - NEW COAX GROUND BAR
NO SCALE

NOTE: NO-OX SHALL BE USED ON ALL CONNECTIONS TO GROUND BAR.



TEI
TELECENT ENGINEERING INC.
2216 COLUMBIAN ROAD, SUITE 1
FROST BELLS, MD 21752
410-492-5816
www.tei-eng.com



1997 ANNAPOLIS PKWY, SUITE 200
ANNAPOLIS, MD 21401
PHONE: (410) 582-8043
FAX: (410) 220-2982

SITE ID: SIMD01045
SITE NAME: DUNNAVANT RELO FOR BOYER PLACE (YESHIVA TEMP)
(FA NUMBER: 12573579)
SITE ADDRESS: 2010 LINDEN LANE ROCKVILLE, MD 20810 MONTGOMERY COUNTY

REVISION BLOCK		
NO.	DESCRIPTION	DATE
1	PERMIT DWG-5	01/13/2023



I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, TIMOTHY JOHN SMITH, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MARYLAND, LICENSE NO. 21809, EXPIRATION DATE, MAY 08, 2025.

DRAWN BY: BLN
DESIGNED BY: BLN/TJB
ORIGINAL DATE: 06/16/2023
TEI PROJECT#: 23014L
DESIGN SCALE: AS NOTED



Know what's below. Call before you dig.
PROJECT NUMBER: SEE THIS DRAWING DATE: THIS
THIS DRAWING DATE INCLUDES NECESSARY INFORMATION FOR UNDERGROUND UTILITY CONSTRUCTION MUST BE DONE IN COMPLIANCE WITH THE OCCUPATIONAL SAFETY AND HEALTH ACT OF 1970 AND ALL RELATED REGULATIONS APPLICABLE TO THE PROJECT.

SHEET TITLE
Details

SHEET NUMBER

G-2

Exhibit 19
OZAH Case No: CU 24-14