


NOTE *
DUE TO CURVATURE, ACTUAL
DIMENSIONS ARE GREATER MEASURED
ALONG THE FLOW LINE.

PLAN

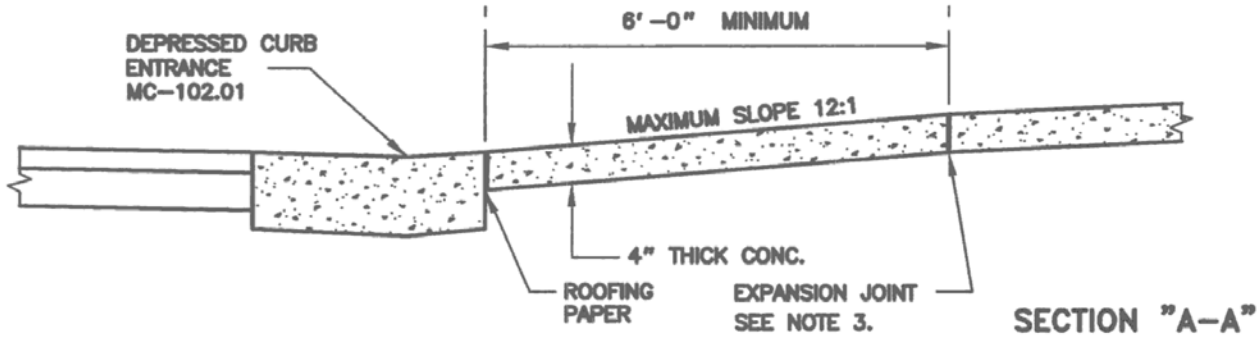

GENERAL NOTES

1. REFER TO MARYLAND STATE HIGHWAY ADMINISTRATION SPECIFICATIONS FOR MATERIAL AND METHODS OF CONSTRUCTION.
2. SIDEWALK RAMPS SHOULD BE LOCATED AS INDICATED. HOWEVER, EXISTING SURFACE UTILITIES AND EXISTING OR PROPOSED GEOMETRICS MAY AFFECT PLACEMENT.
3. EXPANSION JOINT MATERIAL SHALL BE 1/2 INCH PREFORMED CORK, TRIMMED AND SEALED WITH NON-STAINING, TWO COMPONENT POLYSULFIDE OR POLYURETHANE ELASTOMERIC TYPE SEALANT, COMPLYING WITH ASTM-C920.

<p>APPROVED <u>14 APR 06</u> DATE</p> <p><i>Anthony [Signature]</i> DIRECTOR, DEPT. OF PUBLIC WORKS & TRANSPORTATION</p> <p><i>Holger [Signature]</i> for CHIEF, DIV. OF CAP. DEV.</p>	<p>REVISED</p> <p> ASTM-C920 4/2006</p>	<p>MONTGOMERY COUNTY DEPARTMENT OF PUBLIC WORKS & TRANSPORTATION</p> <p>RESIDENTIAL SIDEWALK RAMP</p> <p>STANDARD NO. MC-112.01</p>
--	---	---