




RADIUS	A	B
30'	5'	21'
40'	8'	23'
50'	11'	26'

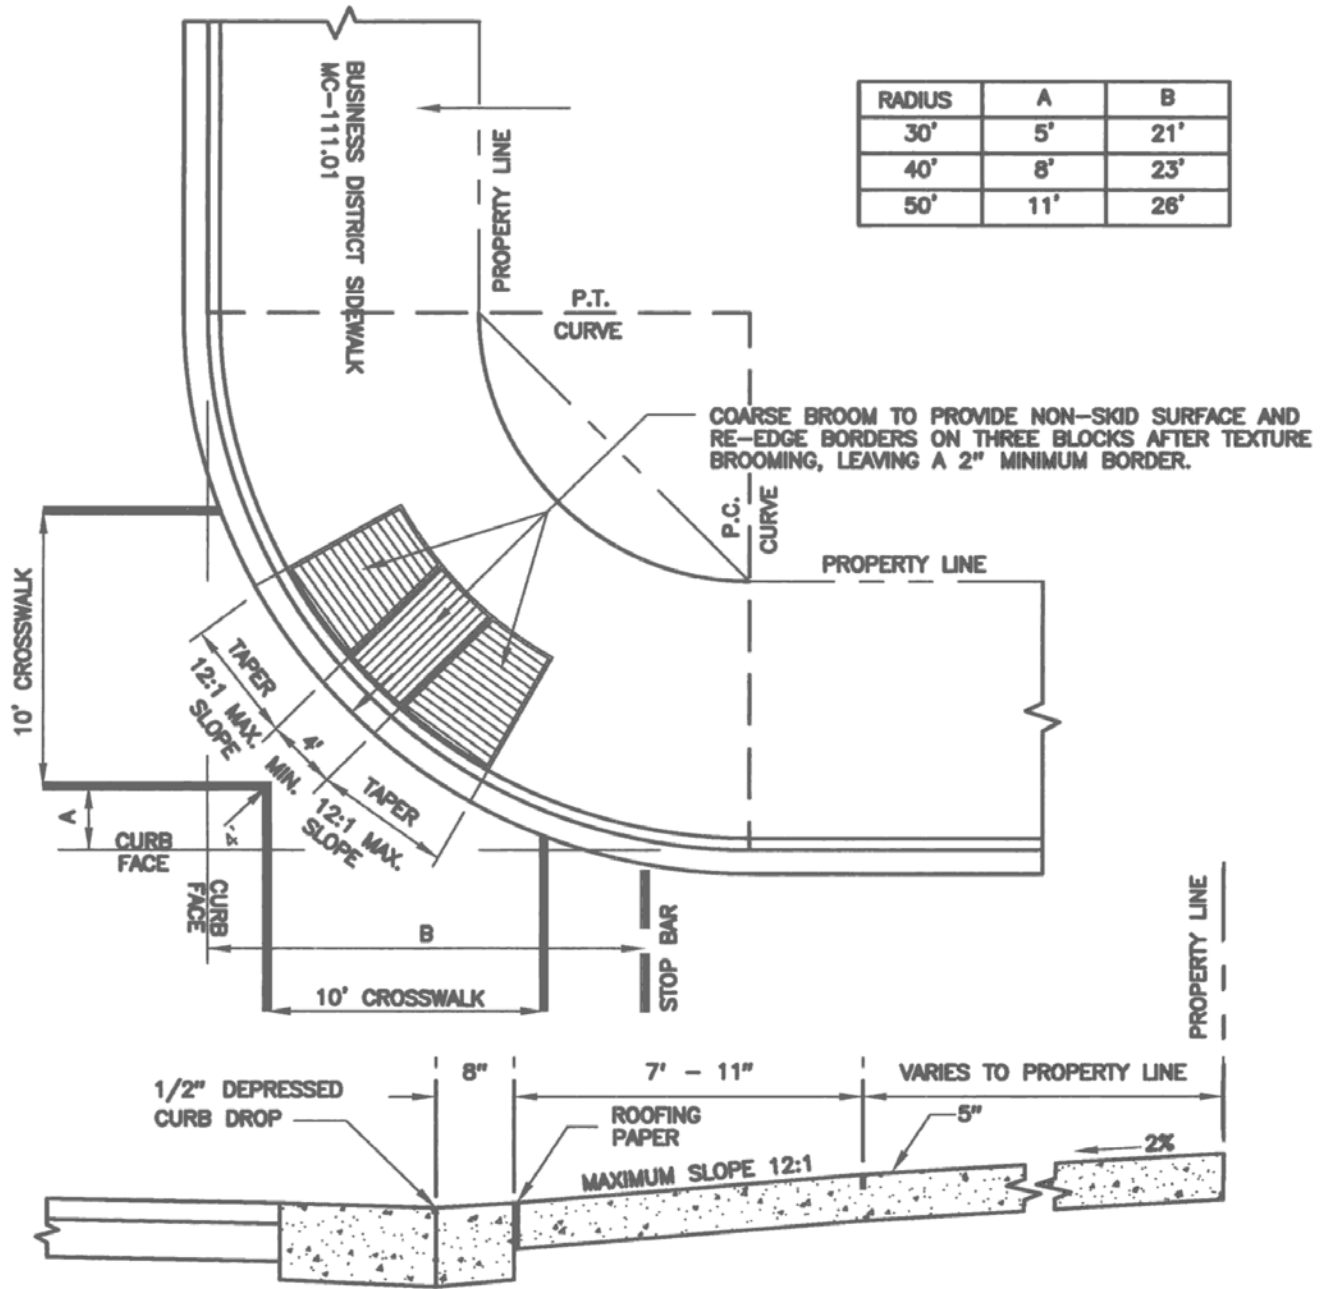

**GENERAL NOTES**

1. THIS STANDARD TO BE USED WITH CURB RADIUS OF 30' OR GREATER.
2. REFER TO MARYLAND STATE HIGHWAY ADMINISTRATION SPECIFICATIONS FOR MATERIALS AND METHODS OF CONSTRUCTION.
3. SIDEWALK RAMPS SHOULD BE LOCATED AS INDICATED, HOWEVER, EXISTING SURFACE UTILITIES MAY AFFECT PLACEMENT.
4. EXPANSION JOINT MATERIAL SHALL BE 1/2 INCH PREFORMED CORK, TRIMMED AND SEALED WITH NON-STAINING, TWO COMPONENT POLYSULFIDE OR POLYURETHANE ELASTOMERIC TYPE SEALANT, COMPLYING WITH ASTM-C920. 

<p><b>APPROVED</b> 14 APR '06 DATE</p> <p><i>Auth [Signature]</i> DIRECTOR, DEPT. OF PUBLIC WORKS &amp; TRANSPORTATION</p> <p><i>Holger [Signature]</i> for CHIEF, DIV. OF CAP. DEV.</p>	<p><b>REVISED</b></p> <p> ASTM-C920 4/2006</p>	<p>MONTGOMERY COUNTY DEPARTMENT OF PUBLIC WORKS &amp; TRANSPORTATION</p> <p><b>BUSINESS DISTRICT SIDEWALK SINGLE RAMP</b></p> <p><b>STANDARD NO. MC-113.01</b></p>
--	---	--