



APPROVED CONNECTION FOR CORRUGATED METAL PIPE  
 ASTM A760  
CORRUGATED BAND WITH RODS AND LUGS

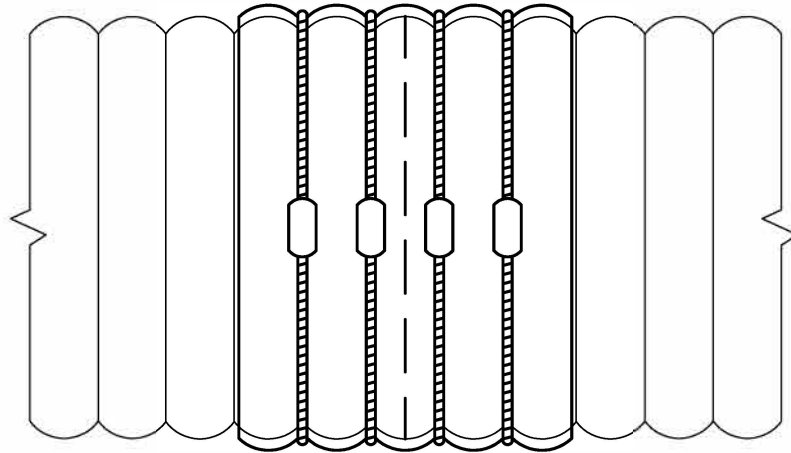


**Notes:**

1. Use of a corrugated band is required.
2. Sleeve gasket(s) are required.
3. Strip gaskets are not permissible.
4. Sleeve gasket must be one piece; total width of one sleeve must equal or exceed 24".
5. A minimum of two indentations of band must rest in two indentations on each end of pipe.
6. A minimum of four rods and lugs are required. Two rods and lugs on each end of pipe.
7. Rods to be supplied by pipe supplier and must be a minimum of 7/16" in diameter.
8. All thread rod is not acceptable. Rod must be smooth bar type.
9. Gaskets to be lubricated on the outside before the band is applied.

CORRUGATED BAND

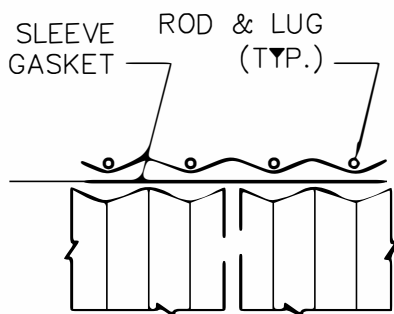

APPROVED  
 SLEEVE GASKET

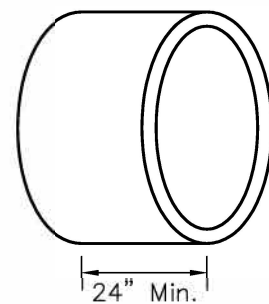

MONTGOMERY COUNTY  
 DEPARTMENT OF PERMITTING  
 SERVICES  
 WATER RESOURCES

CMP BAND  
 CONNECTION  
 DETAIL

DATE: 12/03

SCALE: NONE