



# MONTGOMERY COUNTY EXECUTIVE ORDER

Offices of the County Executive • 101 Monroe Street • Rockville, Maryland 20850

Subject Fire Lane Establishment Order South Lake Elementary School	Executive Order No. 015-22	Subject Suffix
Originating Department Montgomery County Department of Permitting Services	Department Number MCDPS 3-22	Effective Date 1/18/2022

### Fire Lane Establishment Order

Pursuant to Section 22 - 33, Montgomery County Code, 1971, as amended, you are hereby notified that a Fire Lane has been established as described in this order. You are hereby ordered to post fire lane signs and paint curbs/pavement (painting optional) as identified below. When signs and paint work (painting optional) have been completed, this order will authorize the enforcement of this Fire Lane by appropriate police and fire officials. Compliance with this order must be achieved within 30 days of receipt.

LOCATION: 18201 Contour La.  
\_\_\_\_\_  
\_\_\_\_\_

All areas where indicated by signs and paint.

SIGNS -- (See attached diagram for location of sign placement)



\$250 FINE  
FIRE LANE

Signs must be posted so that it is not possible to park a vehicle without being in sight of a sign. Signs may be no further apart than 100 feet

(Red letters on white background)

PAINT -- (See attached diagram if painting).

Paint must be traffic yellow with lines of sufficient width to be readily identifiable/readable by motor vehicle operators.

*Richard E Merck*

\_\_\_\_\_  
Fire Marshal, Montgomery County Department of Permitting Services



MONTGOMERY COUNTY FIRE AND RESCUE SERVICE

Date: 01/05/2022

Fire Lane Establishment Order

Pursuant to Section 22-33, Montgomery County Code, 1971, as amended, you are hereby notified that a Fire Lane has been established as described in this order. You are hereby ordered to post fire lane signs and paint curbs/pavement as identified below. When signs or paint work has been completed, this order will authorize the enforcement of this Fire Lane by appropriate police or fire officials. Compliance with this order must be achieved within 30 days of receipt when any of the following conditions are met:

- One or more structures addressed from the subject road are occupied;
• The road or accessway is available for use and at least one building permit for an address on the subject road has been issued; or
• The road or accessway is necessary fire department access.

LOCATION: South Lake Elementary School
18201 Contour Lane, Gaithersburg, MD 20877

Delineate all areas where indicated by signs and/or paint.

[X] SIGNS -- (See attached diagram for location of sign placement)



(Red letters on white background)

Signs must be posted so that it is not possible to park a vehicle without being in sight of a sign. Signs may be no further apart than 100 feet.

[ ] PAINT -- (See attached diagram when painting is required)

Paint must be traffic yellow with lines of Sufficient width to be readily identifiable/readable by motor vehicle operators.

LS1189

Signature of Order Writer/I.D. #

January 13, 2022

Cc: Fire Code Enforcement Section
Attachment: Fire Lane Diagram

FIRE LANE ESTABLISHMENT FORM

BUILDING OR SUBDIVISION NAME: South Lake Elementary School

FIRE LANE LOCATION/ADDRESS: 18201 Contour Lane, Gaithersburg, MD 20877

See attached drawing for designated fire lanes:

I have received the drawing and instructions for installing the designated fire lanes on property not owned by state or local government.

NAME AND TITLE OF PROPERTY REPRESENTATIVE

NAME: Mr. Gary Mosesman TITLE: Director, Division of Construction MCPS


SIGNATURE: 

PHONE: 240-314-1000 DATE: 24 1/5/22

ADDRESS (where processed order will be mailed):

45 W. Gude Drive, Suite 4300, Rockville MD 20850

The designated fire lanes are the minimum necessary for fire/rescue access and are in accordance with Section 22-33 of the Fire Safety Code.


NAME: Marie LaBaw SIGNATURE: 

STA.#: DPS I.D.#: LS1189 DATE: January 13, 2022

Comments: \_\_\_\_\_

Fire Lane Installed Per Order

NAME: \_\_\_\_\_ DATE: \_\_\_\_\_

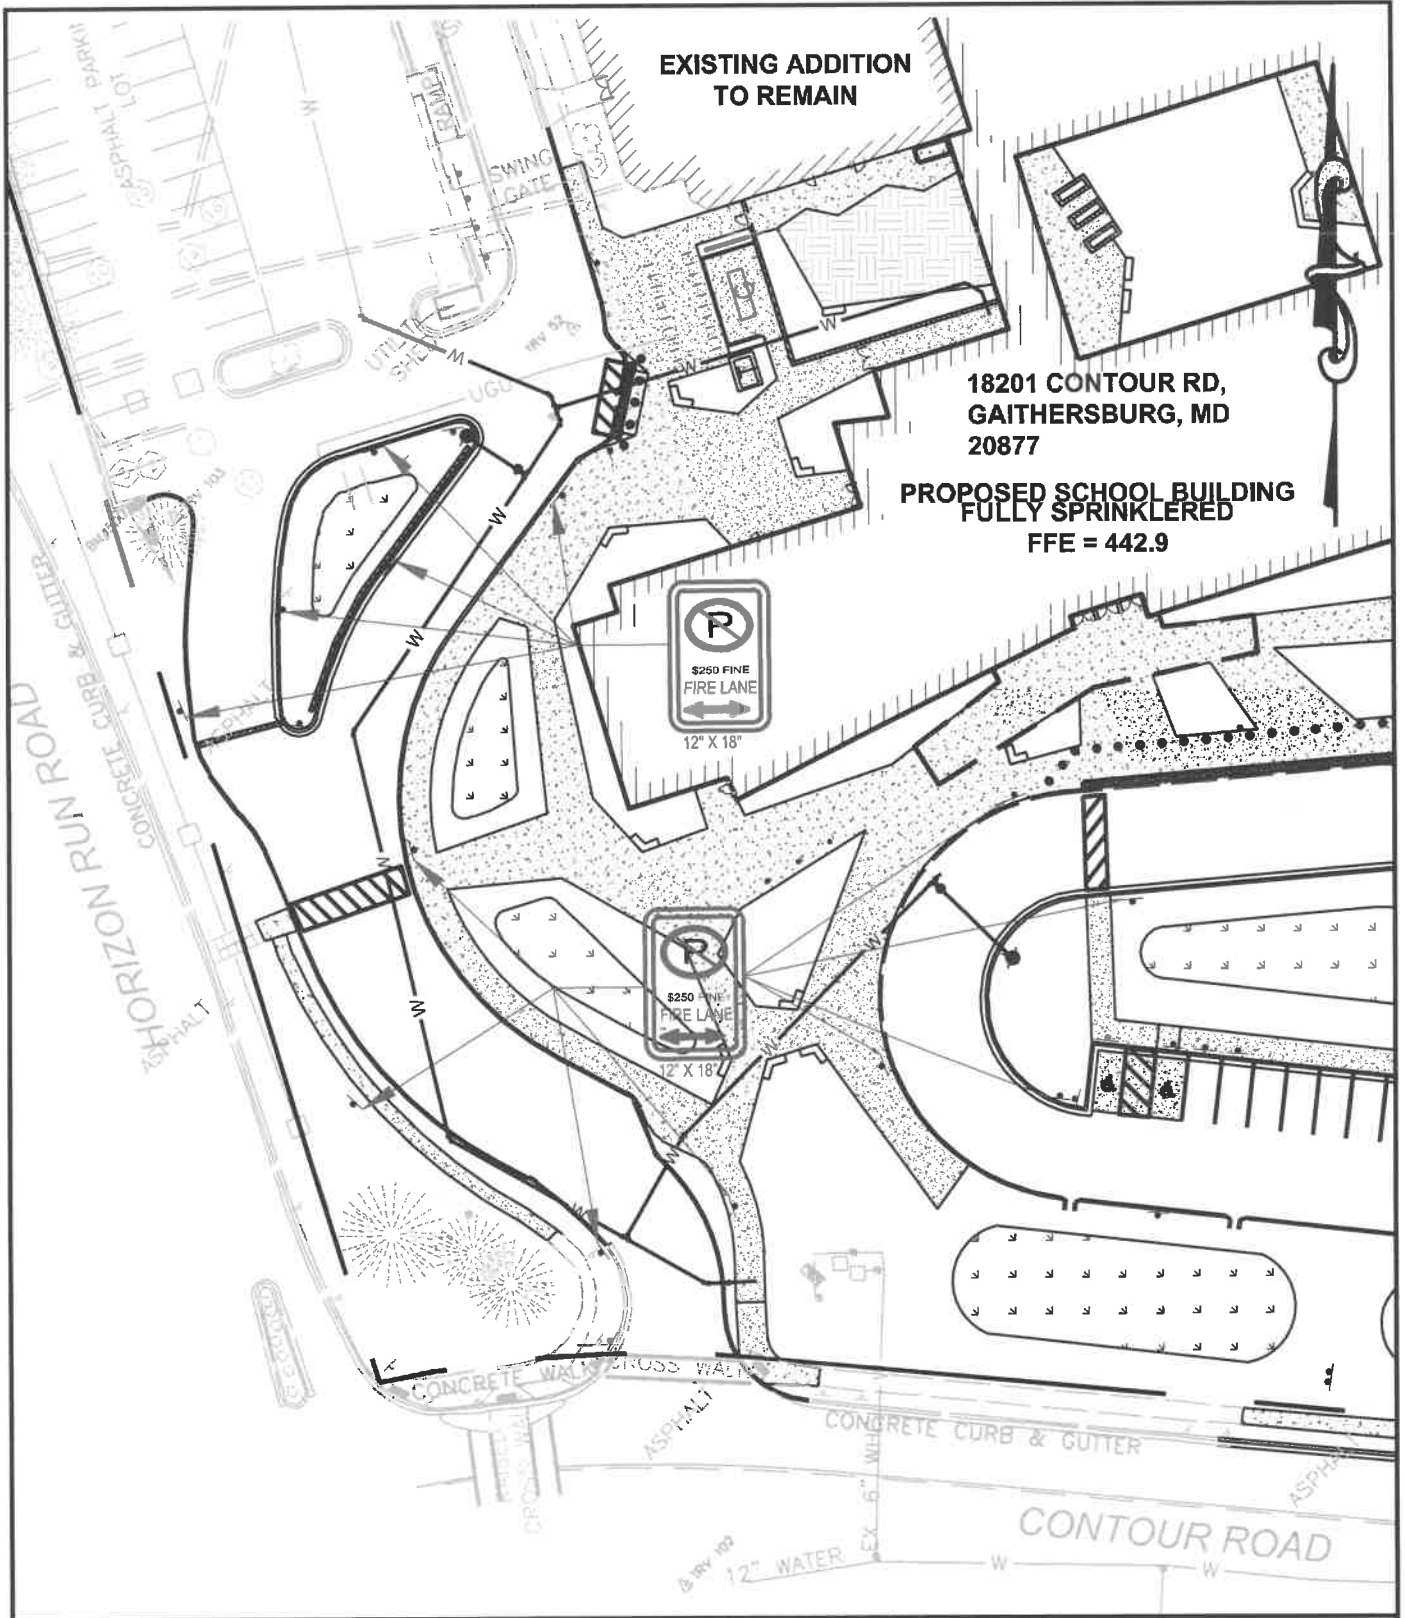

**EXISTING ADDITION  
TO REMAIN**

**18201 CONTOUR RD,  
GAITHERSBURG, MD  
20877**

**PROPOSED SCHOOL BUILDING  
FULLY SPRINKLERED  
FFE = 442.9**

**\$250 FINE  
FIRE LANE**  
12" X 18"

**\$250 FINE  
FIRE LANE**  
12" X 18"



**A. MORTON THOMAS & ASSOCIATES, INC.**  
CONSULTING ENGINEERS  
800 KING FARM BOULEVARD, 4TH FLOOR  
ROCKVILLE, MD 20850  
PH: 301-881-2545 FAX: 301-881-0814  
EMAIL: AMT1@AMTENGINEERING.COM

**SOUTH LAKE ELEMENTARY SCHOOL ADDITION  
18201 CONTOUR RD, GAITHERSBURG, MD 20877**

**Scale: 1" = 50' Date: 1/6/2022**

**Ref Sheet: C-FAP**

**Project No: 20-0302.001**

**Drawn by: JES**

**Checked by: WJP**

**FIRE LANE ORDER 1 OF 3**



