



MONTGOMERY COUNTY EXECUTIVE ORDER

Offices of the County Executive • 101 Monroe Street • Rockville, Maryland 20850

Subject Fire Lane Establishment Order for Josiah Henson Park	Executive Order No. 14-18	Subject Suffix
Originating Department Montgomery County Department of Permitting Services	Department Number MCDPS 8-18	Effective Date 1/31/2018

Fire Lane Establishment Order

Pursuant to Section 22 - 33, Montgomery County Code, 1971, as amended, you are hereby notified that a Fire Lane has been established as described in this order. You are hereby ordered to post fire lane signs and paint curbs/pavement (painting optional) as identified below. When signs and paint work (painting optional) have been completed, this order will authorize the enforcement of this Fire Lane by appropriate police and fire officials. Compliance with this order must be achieved within 30 days of receipt.

LOCATION: 11410 Old Georgetown Rd.

All areas where indicated by signs and paint.

SIGNS - - (See attached diagram for location of sign placement)



\$250 FINE


FIRE LANE

Signs must be posted so that it is not possible to park a vehicle without being in sight of a sign. Signs may be no further apart than 100 feet

(Red letters on white background)

PAINT - - (See attached diagram if painting).

Paint must be traffic yellow with lines of sufficient width to be readily identifiable/readable by motor vehicle operators.

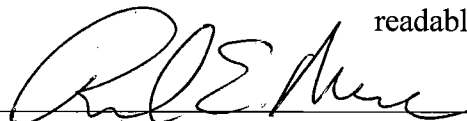

Fire Marshal, Montgomery County Department of Permitting Services



MONTGOMERY COUNTY FIRE AND RESCUE SERVICE

Isiah Leggett
County Executive

Scott E. Goldstein
Fire Chief

Date: Jan 23, 2018

Fire Lane Establishment Order

Pursuant to Section 22-33, Montgomery County Code, 1971, as amended, you are hereby notified that a Fire Lane has been established as described in this order. You are hereby ordered to post fire lane signs and paint curbs/pavement as identified below. When signs or paint work has been completed, this order will authorize the enforcement of this Fire Lane by appropriate police or fire officials. Compliance with this order must be achieved within 30 days of receipt when any of the following conditions are met:

- One or more structures addressed from the subject road are occupied;
- The road or accessway is available for use and at least one building permit for an address on the subject road has been issued; or
- The road or accessway is necessary fire department access.

LOCATION: 11410 Old Georgetown Road Rockville, MD 20852
Josiah Henson Park (Park Address: 11420 Old Georgetown Rd)

Delineate all areas where indicated by signs and/or paint.

SIGNS -- (See attached diagram for location of sign placement)



(Red letters on white background)

Signs must be posted so that it is not possible to park a vehicle without being in sight of a sign. Signs may be no further apart than 100 feet.

PAINT -- (See attached diagram when painting is required)

Paint must be traffic yellow with lines of sufficient width to be readily identifiable/readable by motor vehicle operators.

[Signature] 651189
Signature of Order Writer/I.D. #

Cc: Fire Code Enforcement Section
Attachment: Fire Lane Diagram

FIRE LANE ESTABLISHMENT FORM

BUILDING OR SUBDIVISION NAME: Josiah Henson Park - Visitor Center
FIRE LANE LOCATION/ADDRESS: Josiah Henson Park
11410 Old Georgetown Road, Rockville MD 20852

See attached drawing for designated fire lanes:

I have received the drawing and instructions for installing the designated fire lanes on property not owned by state or local government.

NAME AND TITLE OF PROPERTY REPRESENTATIVE

NAME: Samantha Shron TITLE: Montgomery Parks - Project Manager

SIGNATURE: *Samantha Shron*

PHONE: 301-495-2542 DATE: January 23, 2018

ADDRESS (where processed order will be mailed): M-NCPPC Montgomery County Parks
9500 Brunett Avenue Silver Spring, MD 20901

The designated fire lanes are the minimum necessary for fire/rescue access and are in accordance with Section 22-33 of the Fire Safety Code.


NAME: Marie LaBaw SIGNATURE: *Marie LaBaw*

STA.#: DPS I.D.#: LS1189 DATE: 1/26/2018


Comments: _____

Fire Lane Installed Per Order

NAME: _____ DATE: _____

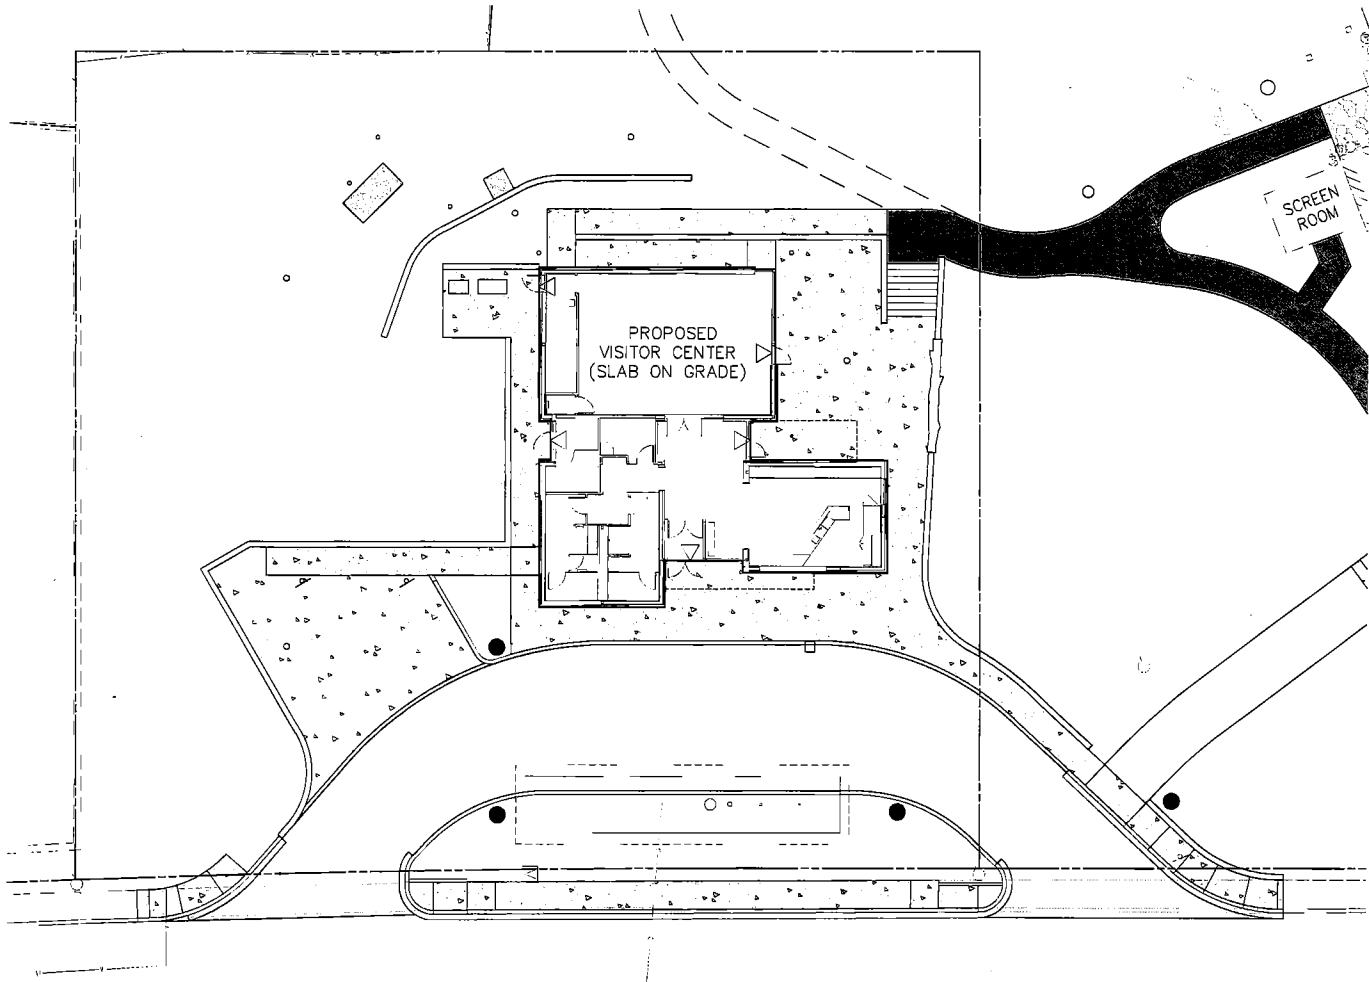

(RED LETTERS ON WHITE BACKGROUND)



Ziga/Sneed LLP
Architects
1005 Morton Street
Baltimore, Maryland 21201
P 410 576 9131
F 410 576 9159
www.zigasneed.com

MECHANICAL ENGINEER
Heath Associates
1385 Concourse Drive
Suite 100
Crownpoint, MD 21086
410 944 4000

STRUCTURAL ENGINEER
Farr & Rice Co.
1385 Concourse Drive NW
Suite 413
Washington, DC 20028
202 223 9944

LANDSCAPE ARCHITECT
Fluys Tenen Landscapes Architects, Inc.
800 N. Tenth Street, 4th Fl.
Baltimore, MD 21201
410 536 5295

LIGHTING DESIGN
Plan Studio
8711 Madison Street
Baltimore, MD 21281
410 442 2100

Professional Certification: I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland.

License No. 32561
Expiration Date 1/8/2020

**The Maryland-National Capital Park and Planning Commission**
Montgomery County Department of Parks
9500 Brunnett Avenue
Silver Spring, Maryland 20901
(301) 495-2535

REVIEW AND APPROVAL		ISSUED FOR PROCUREMENT ON	
		REVISIONS	
Rev. No.	Date	Description	

Josiah Henson Park - Construction Drawings
11420 Old Georgetown Road, Rockville, MD 20852
SCALE: AS SHOWN

FA-4

SHT. # _____ of _____
FOR REVIEW ONLY
NOT FOR CONSTRUCTION

FIRE LANE ORDER